


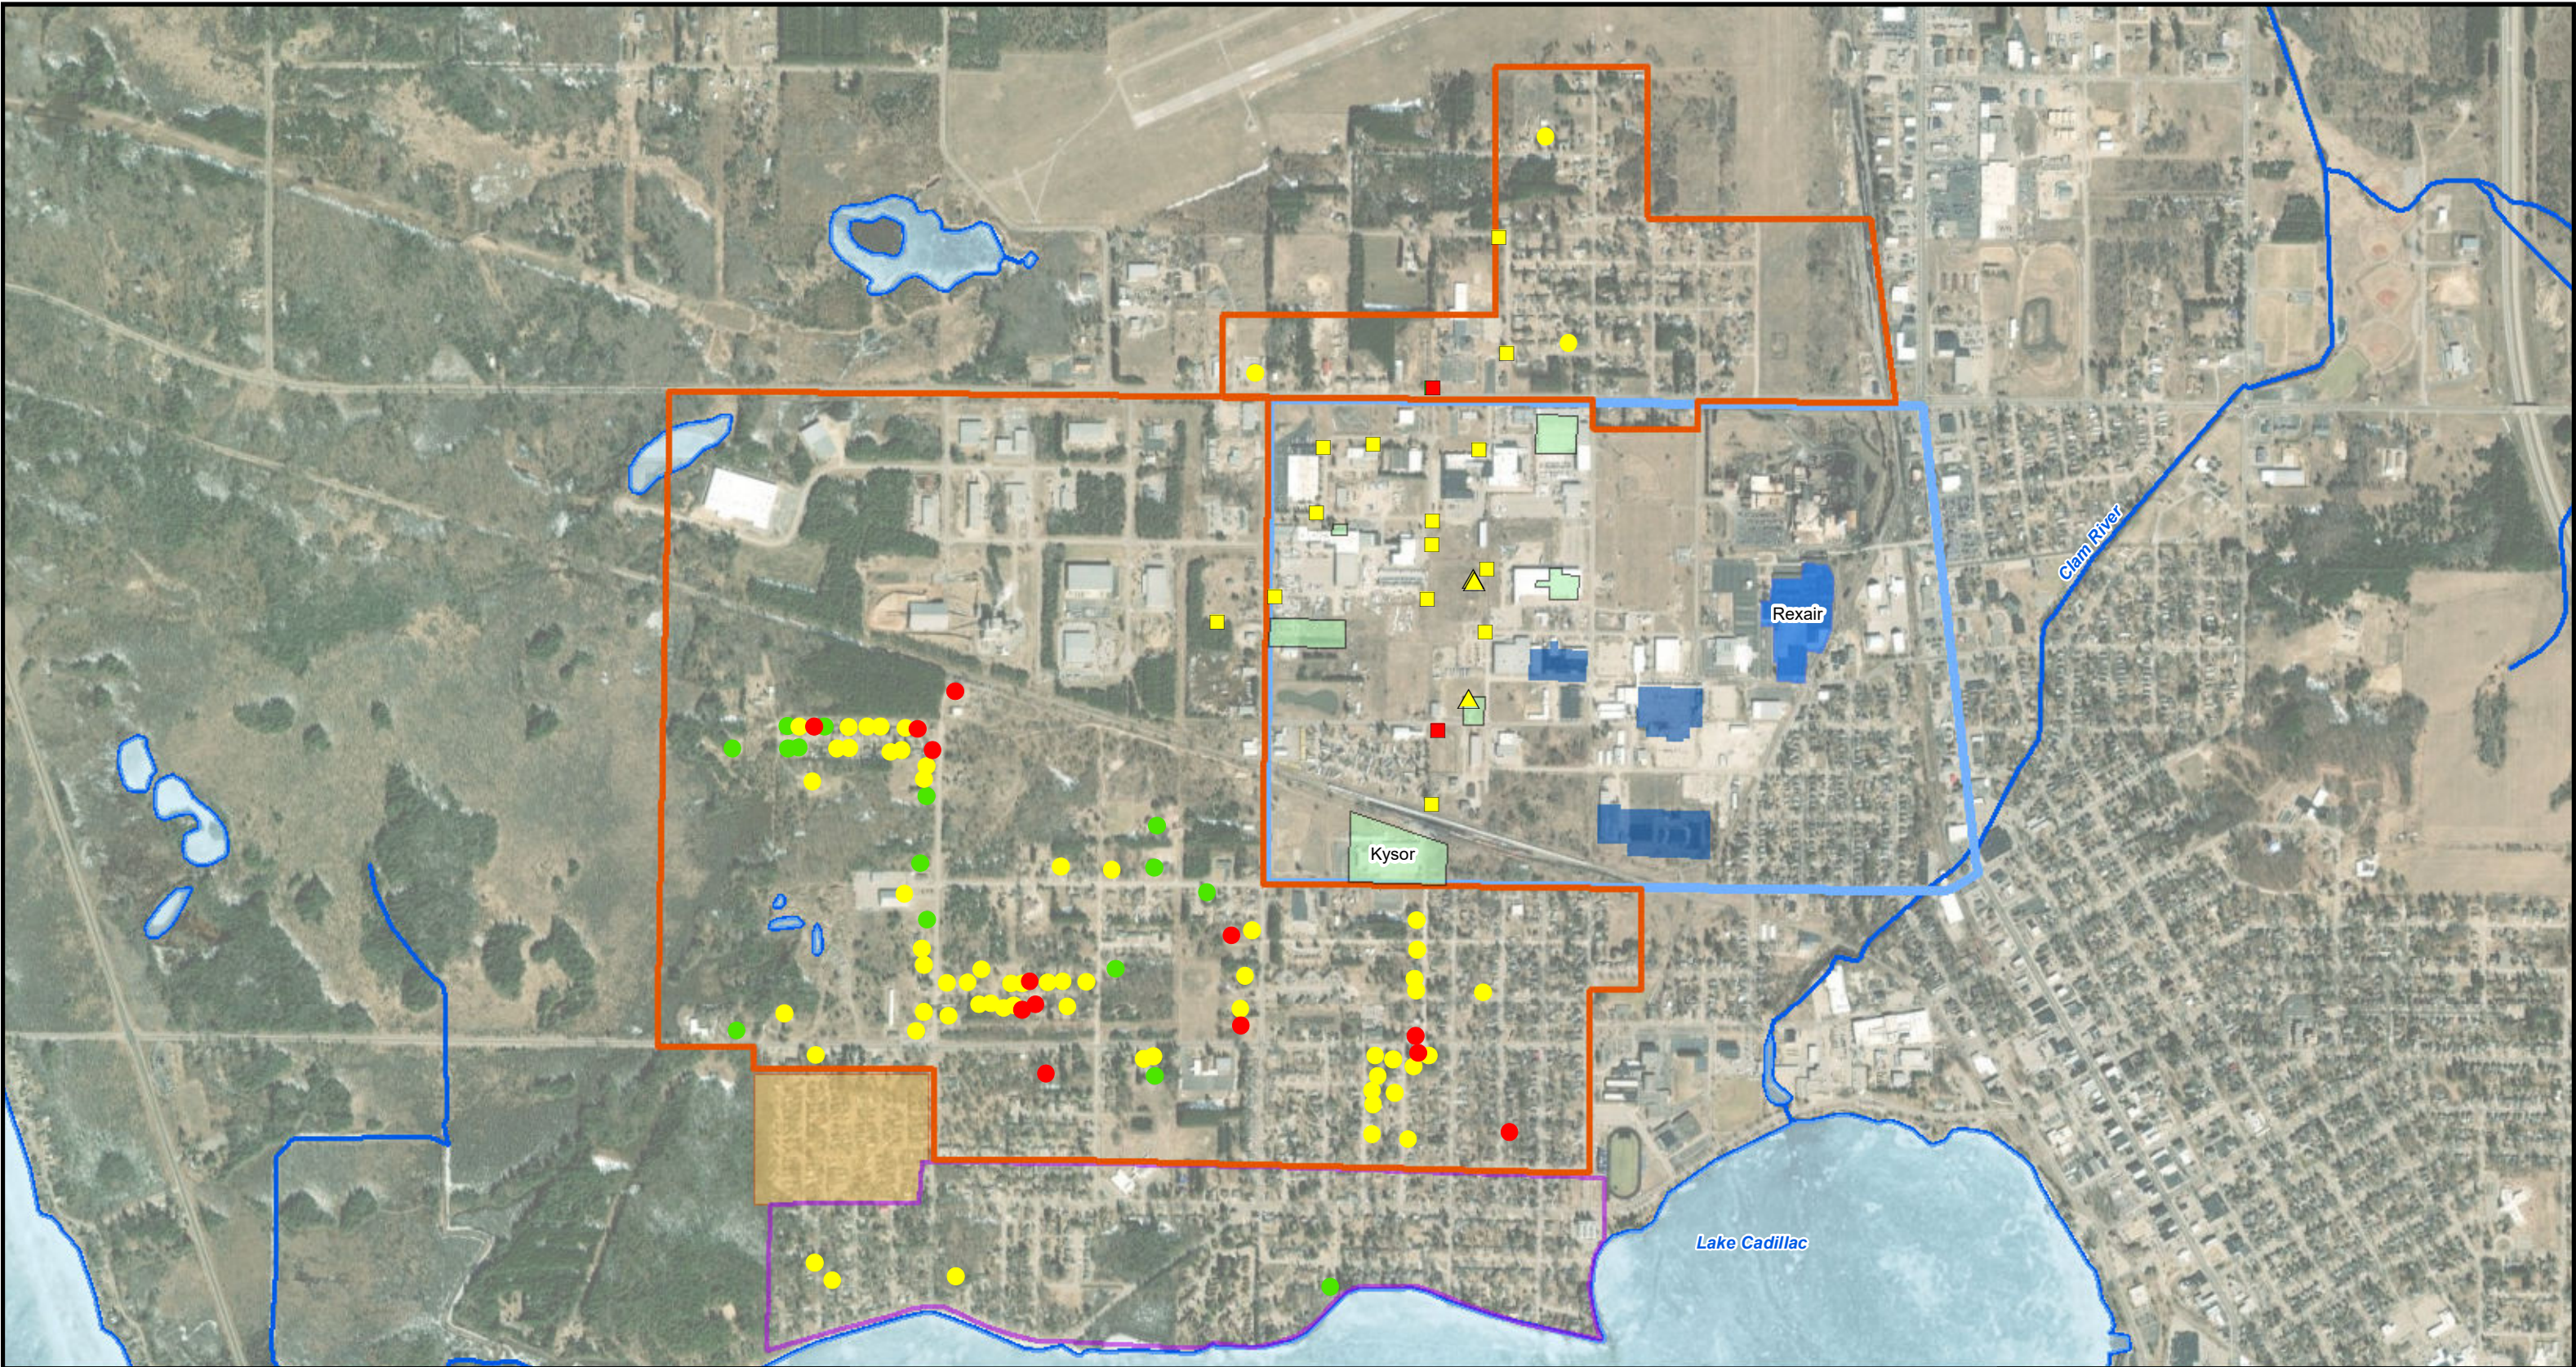

Drawn: DP      Date: 5/27/2025

Approved: DB      Date: 5/27/2025

Project #: 60560354

**Legend**

**Sample Types**

- Residential Wells Sample
- Cadillac Industrial Park Extraction Well
- △ Cadillac Industrial Park Monitoring Well

**PFAS Criteria Heat Map**

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Detections at or Above Michigan DWC

- Surface Water Body
- Proposed Additional Sampling Area
- Sampling Request Area
- Cadillac Industrial Park
- Area Evaluated, no wells
- LDFA Facility
- Rexair Facility
- Other Industrial Facilities

Michigan Drinking Water Criteria (DWC), ppt:  
PFHxA = 400,000  
PFOA = 8  
PFNA = 6  
PFBS = 420  
PFHxS = 51  
PFOS = 16  
HFPO-DA = 370

FIGURE 3

PFAS CRITERIA HEAT MAP

CADILLAC INDUSTRIAL PARK  
AREA OF INTEREST  
WEXFORD COUNTY, MI