


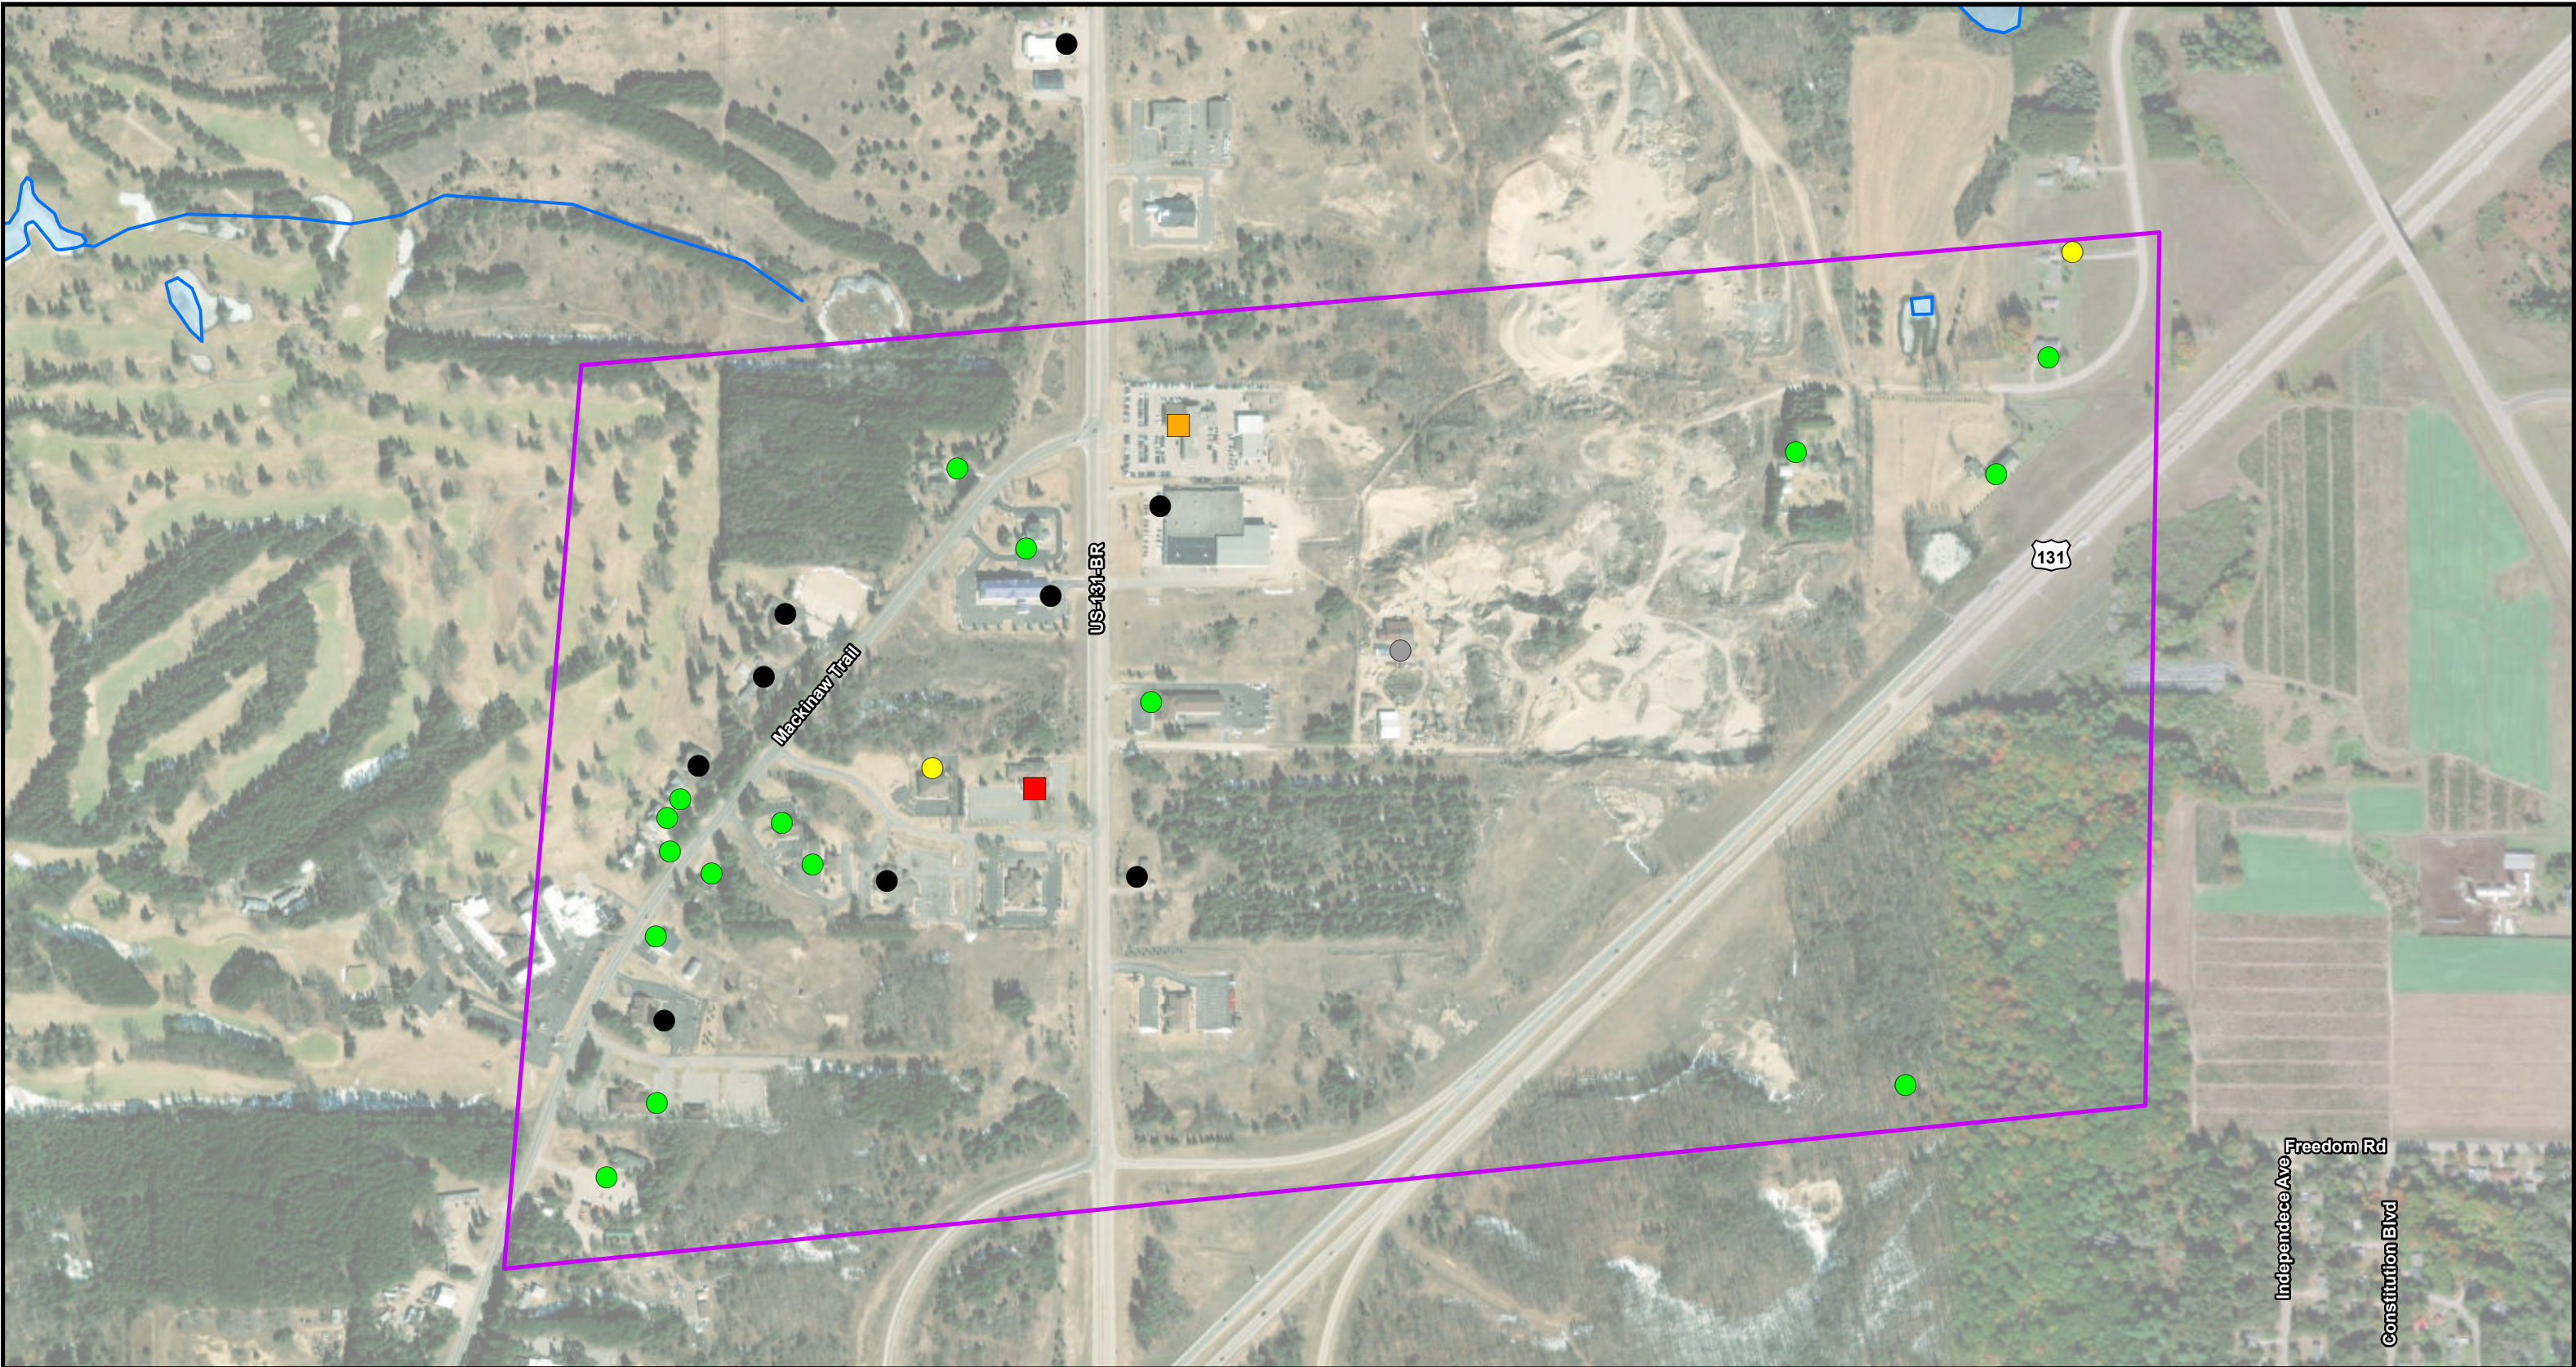

Drawn: DP Date: 5/20/2025

Approved: DB Date: 5/20/2025

Project #: 60560354

Legend
Drinking Water Well Sample
PFAS Criteria Heat Map

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria
- Business with Elevated Levels of PFAS
- Business with Running Annual Average Exceedance
- Surface Water Body

Sample Status

- Canvassed
- Letter Sent
- Proposed Sampling Area

Michigan Drinking Water Criteria (DWC), ppt

- PFHxA = 400,000
- PFOA = 8
- PFNA = 6
- HFPO-DA = 370
- PFBS = 420
- PFHxS = 51
- PFOS = 16

FIGURE 1
PFAS CRITERIA HEAT MAP

US 131 & MACKINAW TRAIL
AREA OF INTEREST
WEXFORD COUNTY, MI