



Drawn: AA Date: 9/3/2025

Approved: DB Date: 9/3/2025

Project #: 60560354

Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

Wexford AOI Sampling Area

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000	PFBS = 420
PFOA = 8	PFHxS = 51
PFNA = 6	PFOS = 16
HFPO-DA = 370	

0 175 350 Feet

FIGURE 3

PFAS CRITERIA HEAT MAP

WEST 32 ROAD, BOON

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI



Drawn: AA

Date: 9/3/2025

Approved: DB

Date: 9/3/2025

Project #: 60560354



Legend

Drinking Water Well Sample

No Detections of the Analyzed PFAS Substances

One or more of the Analyzed PFAS Substances Detected

One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

Wexford AOI Sampling Area

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000

PFBS = 420

PFOA = 8

PFHxS = 51

PFNA = 6

PFOS = 16

HFPO-DA = 370

0

100

200

Feet

FIGURE 3

PFAS CRITERIA HEAT MAP

WEST LAKE MITCHELL

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI



AECOM

Drawn: AA Date: 9/3/2025

Approved: DB Date: 9/3/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria



Wexford AOI Sampling Area



Surface Water Body


Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFBS = 420
PFOA = 8 PFHxS = 51
PFNA = 6 PFOS = 16
HFPO-DA = 370



0 100 200 Feet

**FIGURE 3
PFAS CRITERIA HEAT MAP
EAST LAKE MITCHELL**

**WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI**

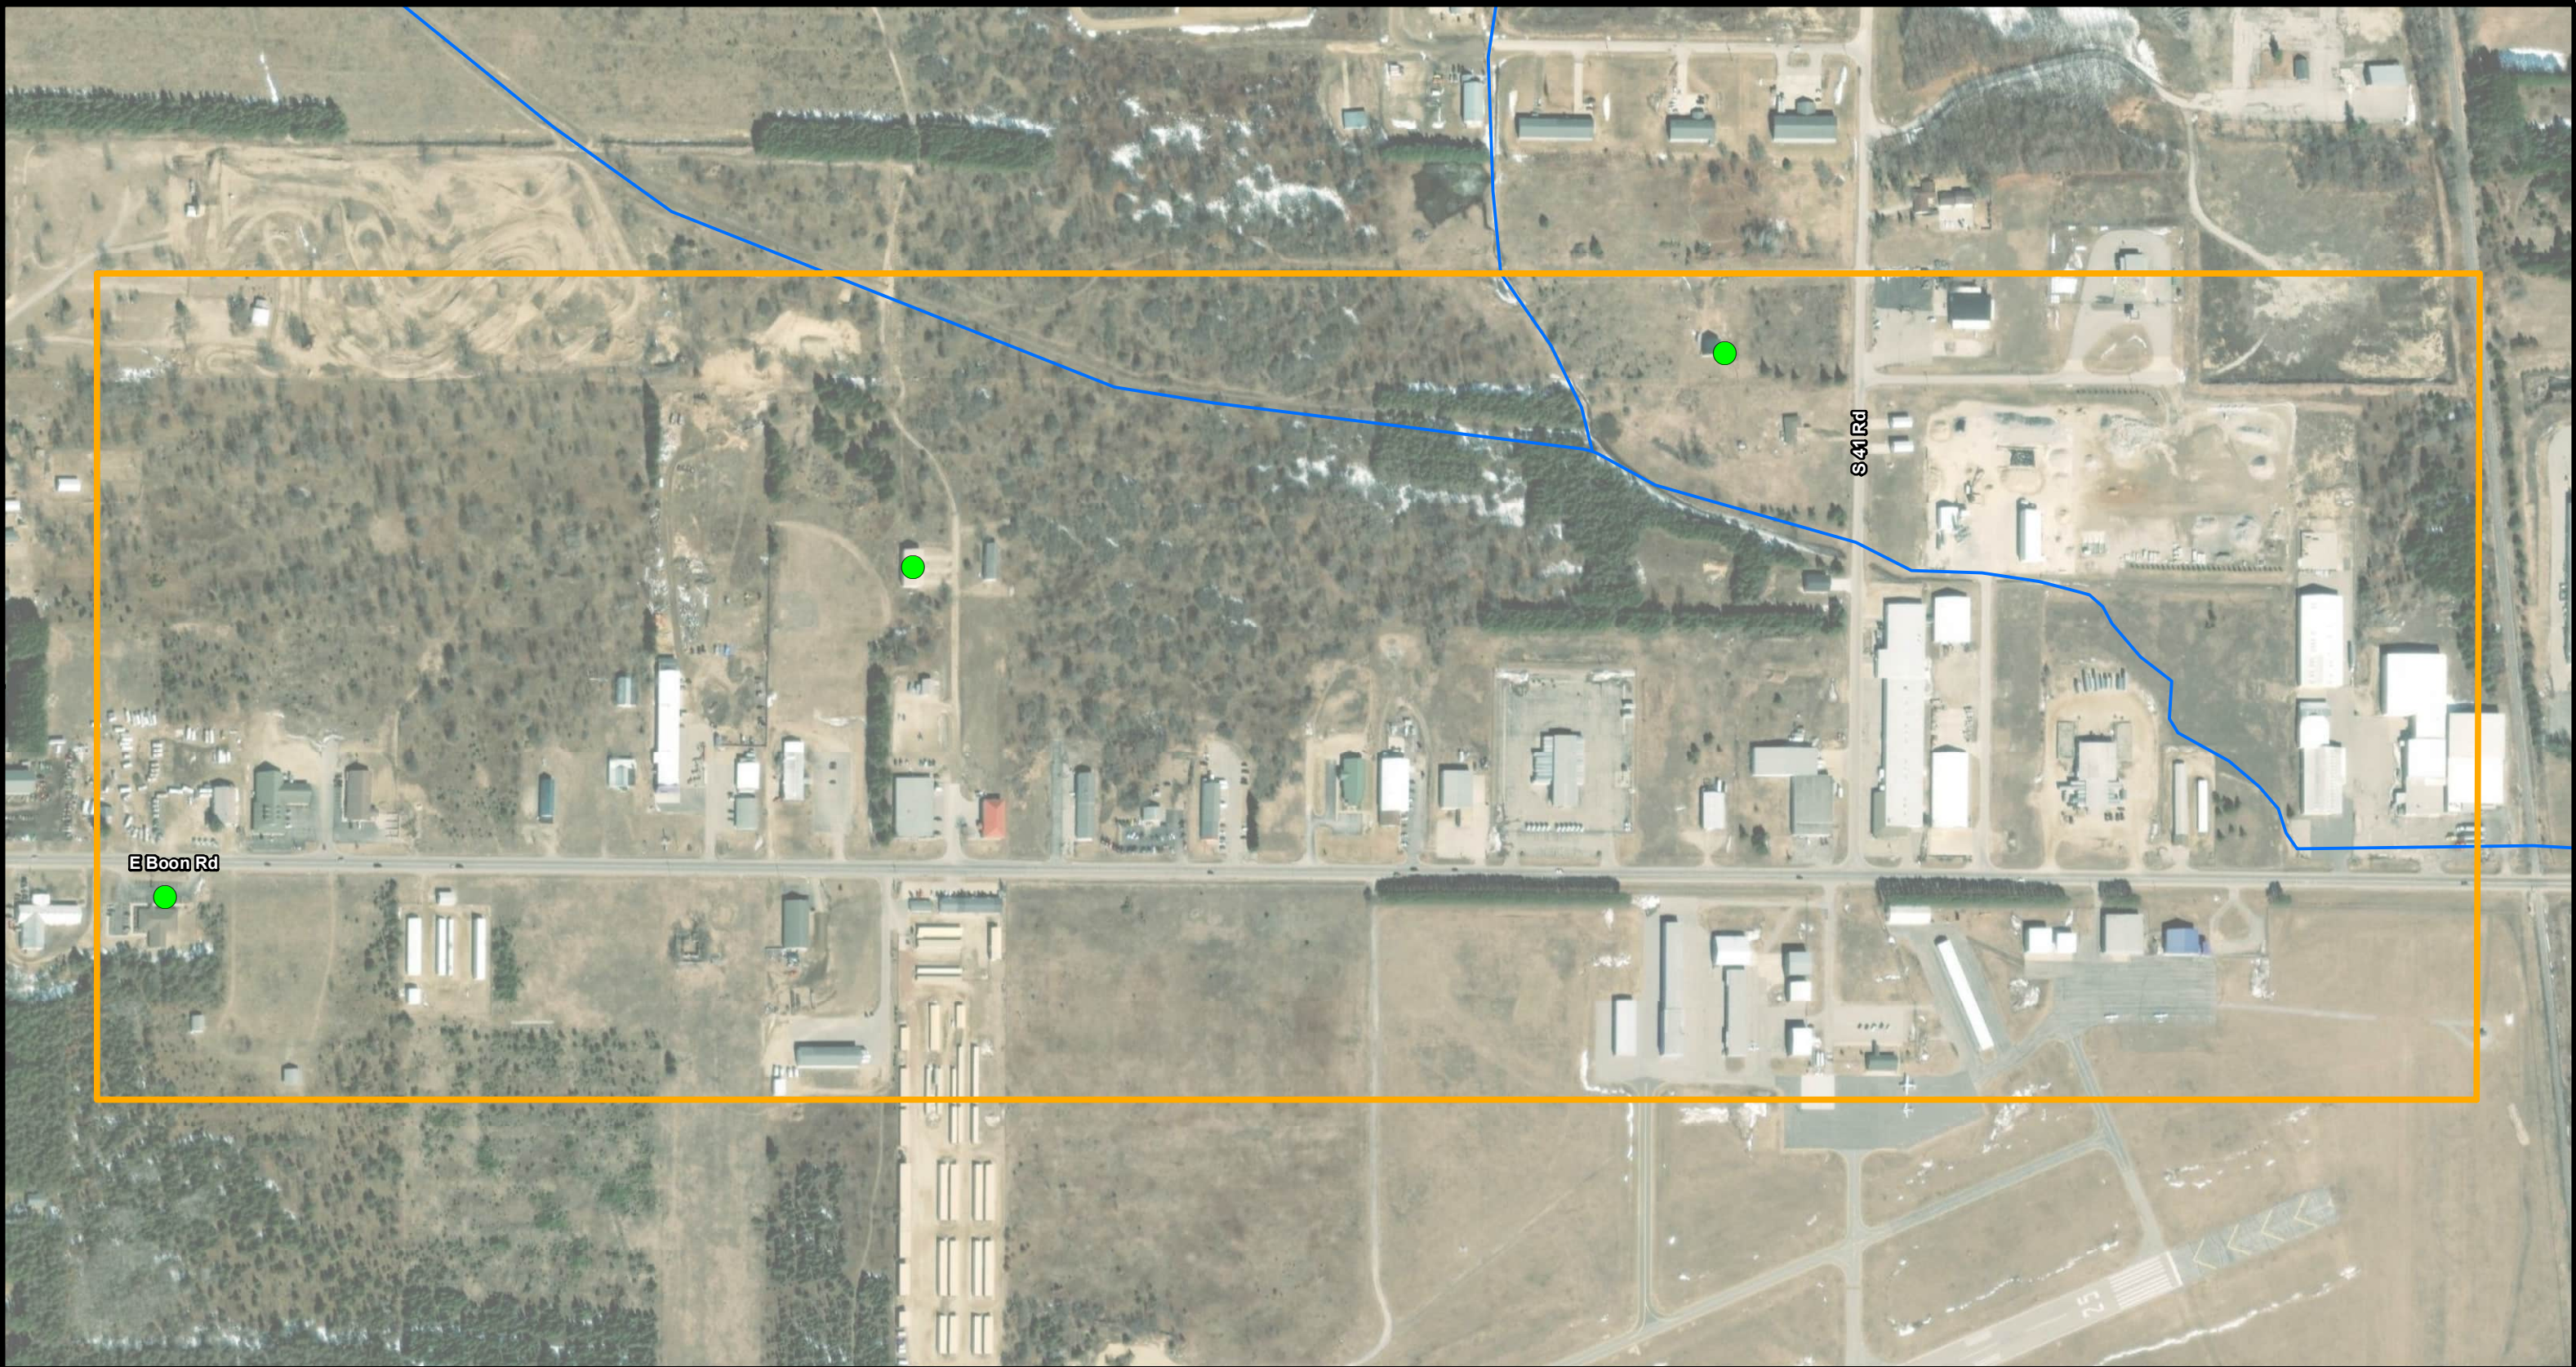

AECOM

Drawn: AA Date: 9/3/2025

Approved: DB Date: 9/3/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria



Wexford AOI Sampling Area



Surface Water Body


Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFBS = 420
PFOA = 8 PFHxS = 51
PFNA = 6 PFOS = 16
HFPO-DA = 370



0 430 860 Feet

**FIGURE 3
PFAS CRITERIA HEAT MAP
EAST 34/BOON ROAD**

**WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI**

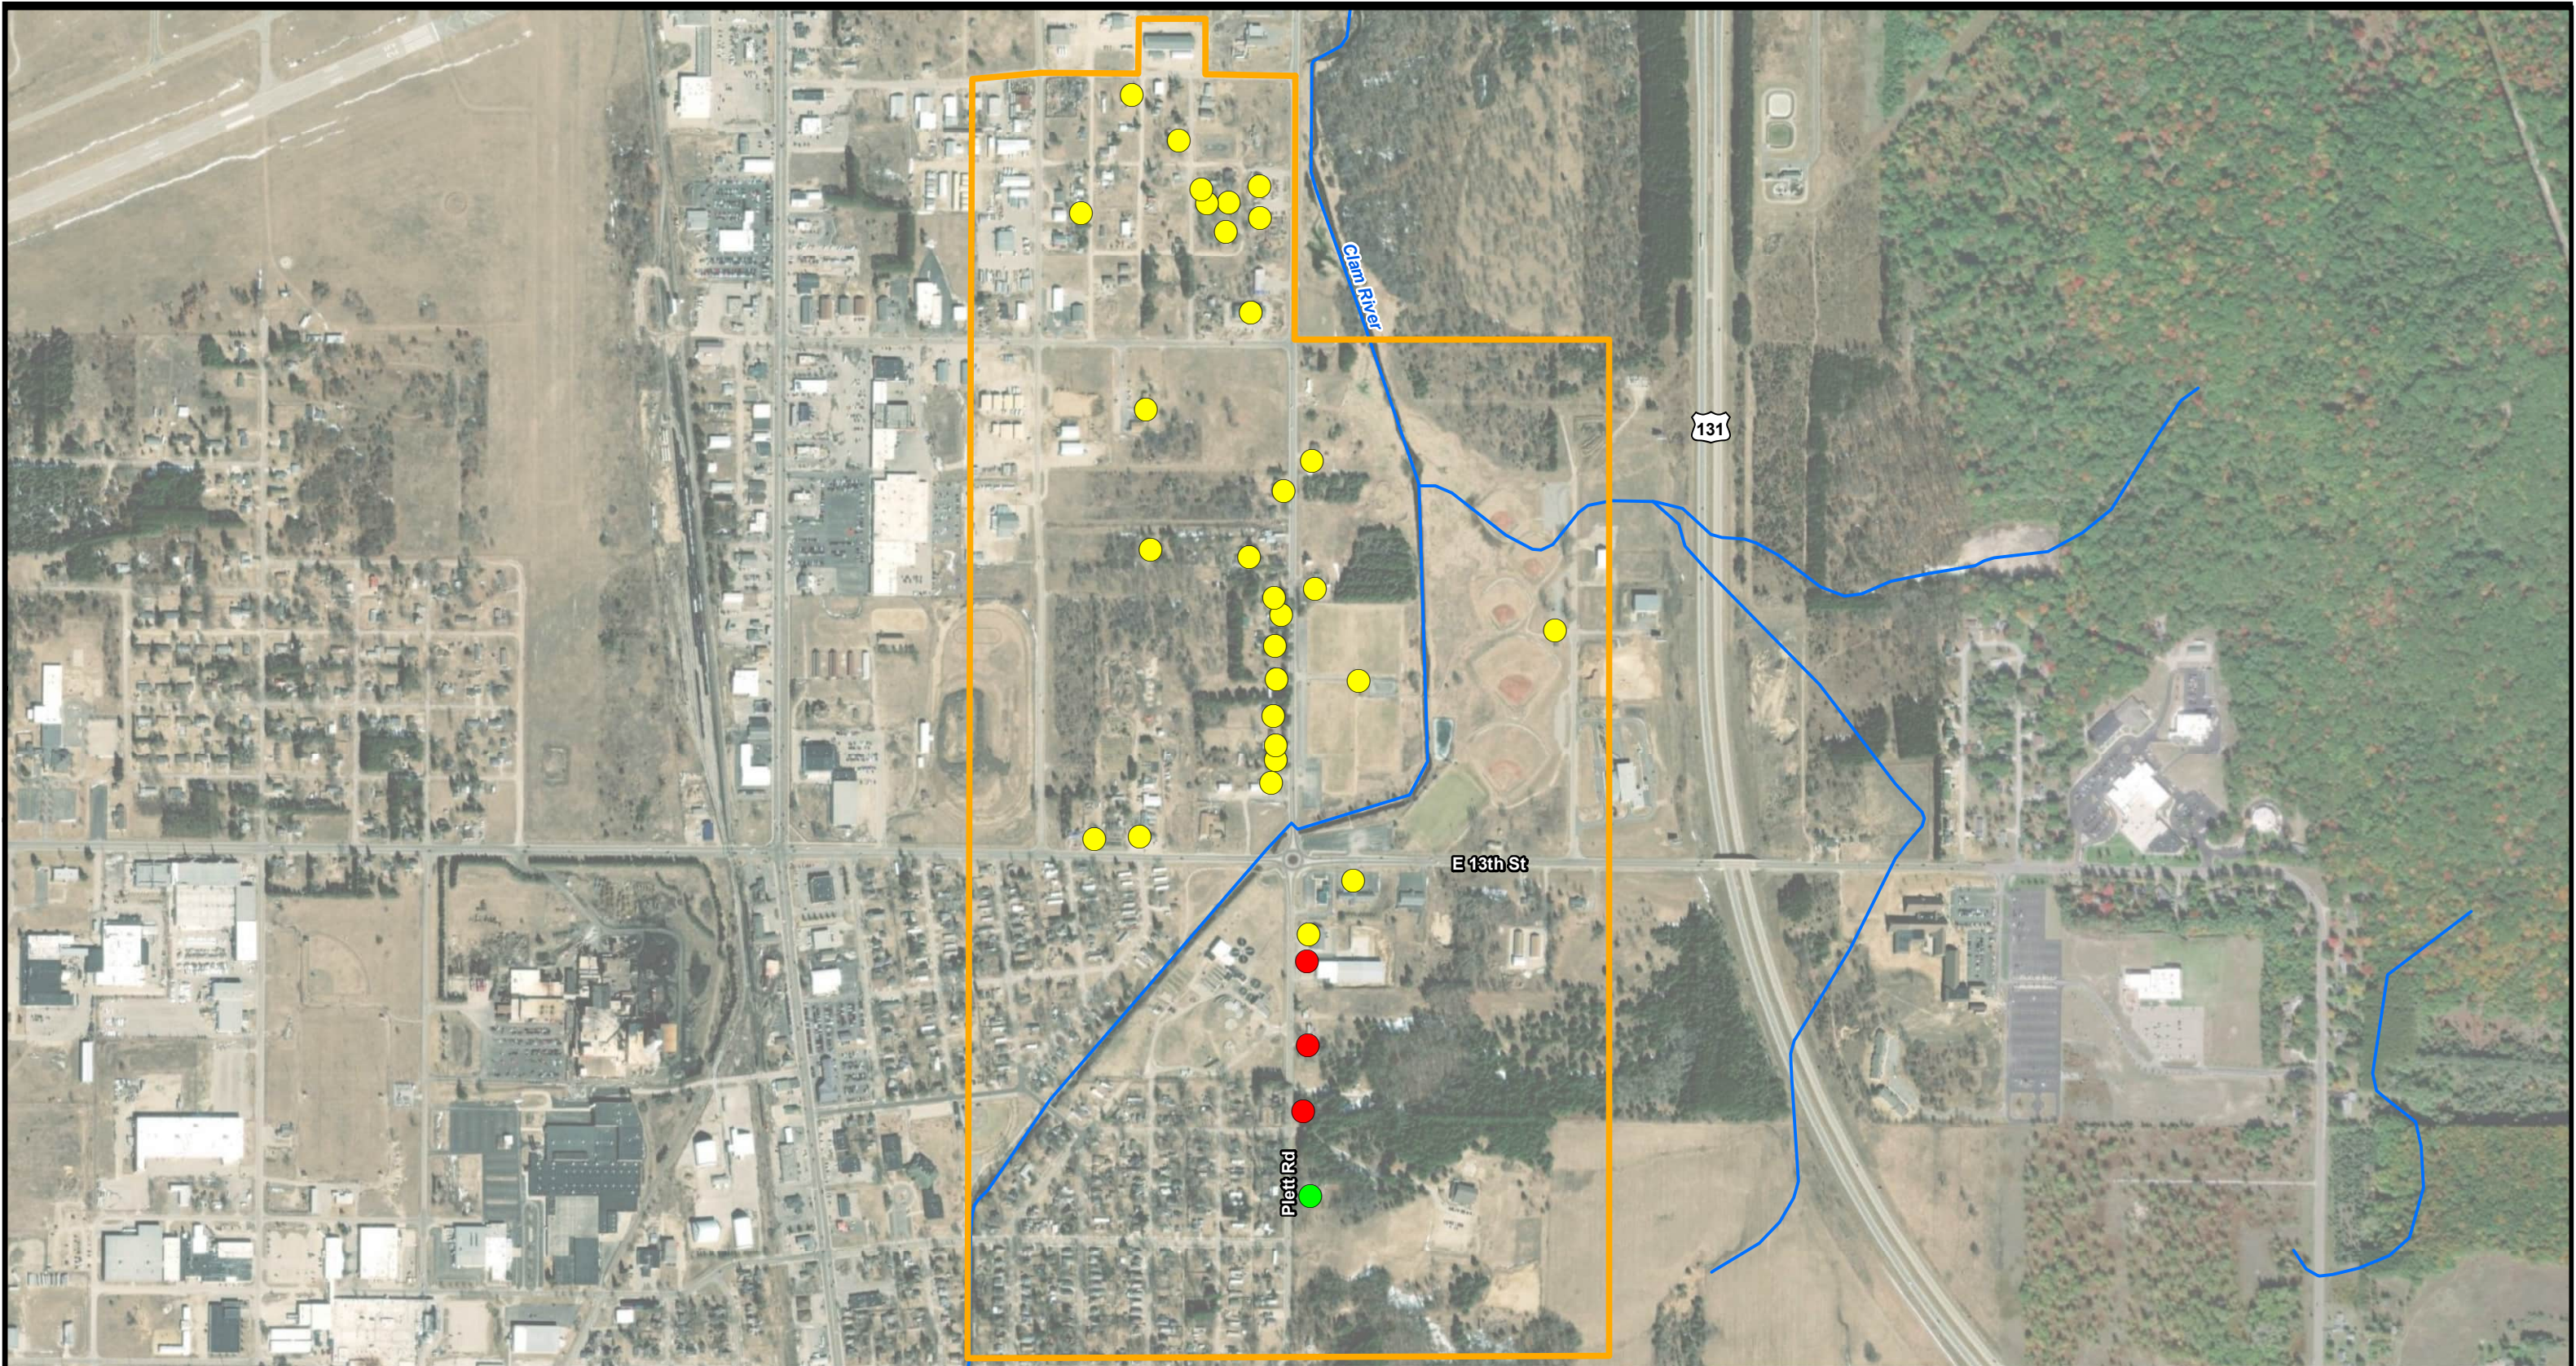

AECOM

Drawn: AA Date: 9/3/2025

Approved: DB Date: 9/3/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria



Wexford AOI Sampling Area



Surface Water Body


Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFBS = 420
PFOA = 8 PFHxS = 51
PFNA = 6 PFOS = 16
HFPO-DA = 370



0 800 1,600 Feet

FIGURE 3
PFAS CRITERIA HEAT MAP
13TH & PLETT

WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI

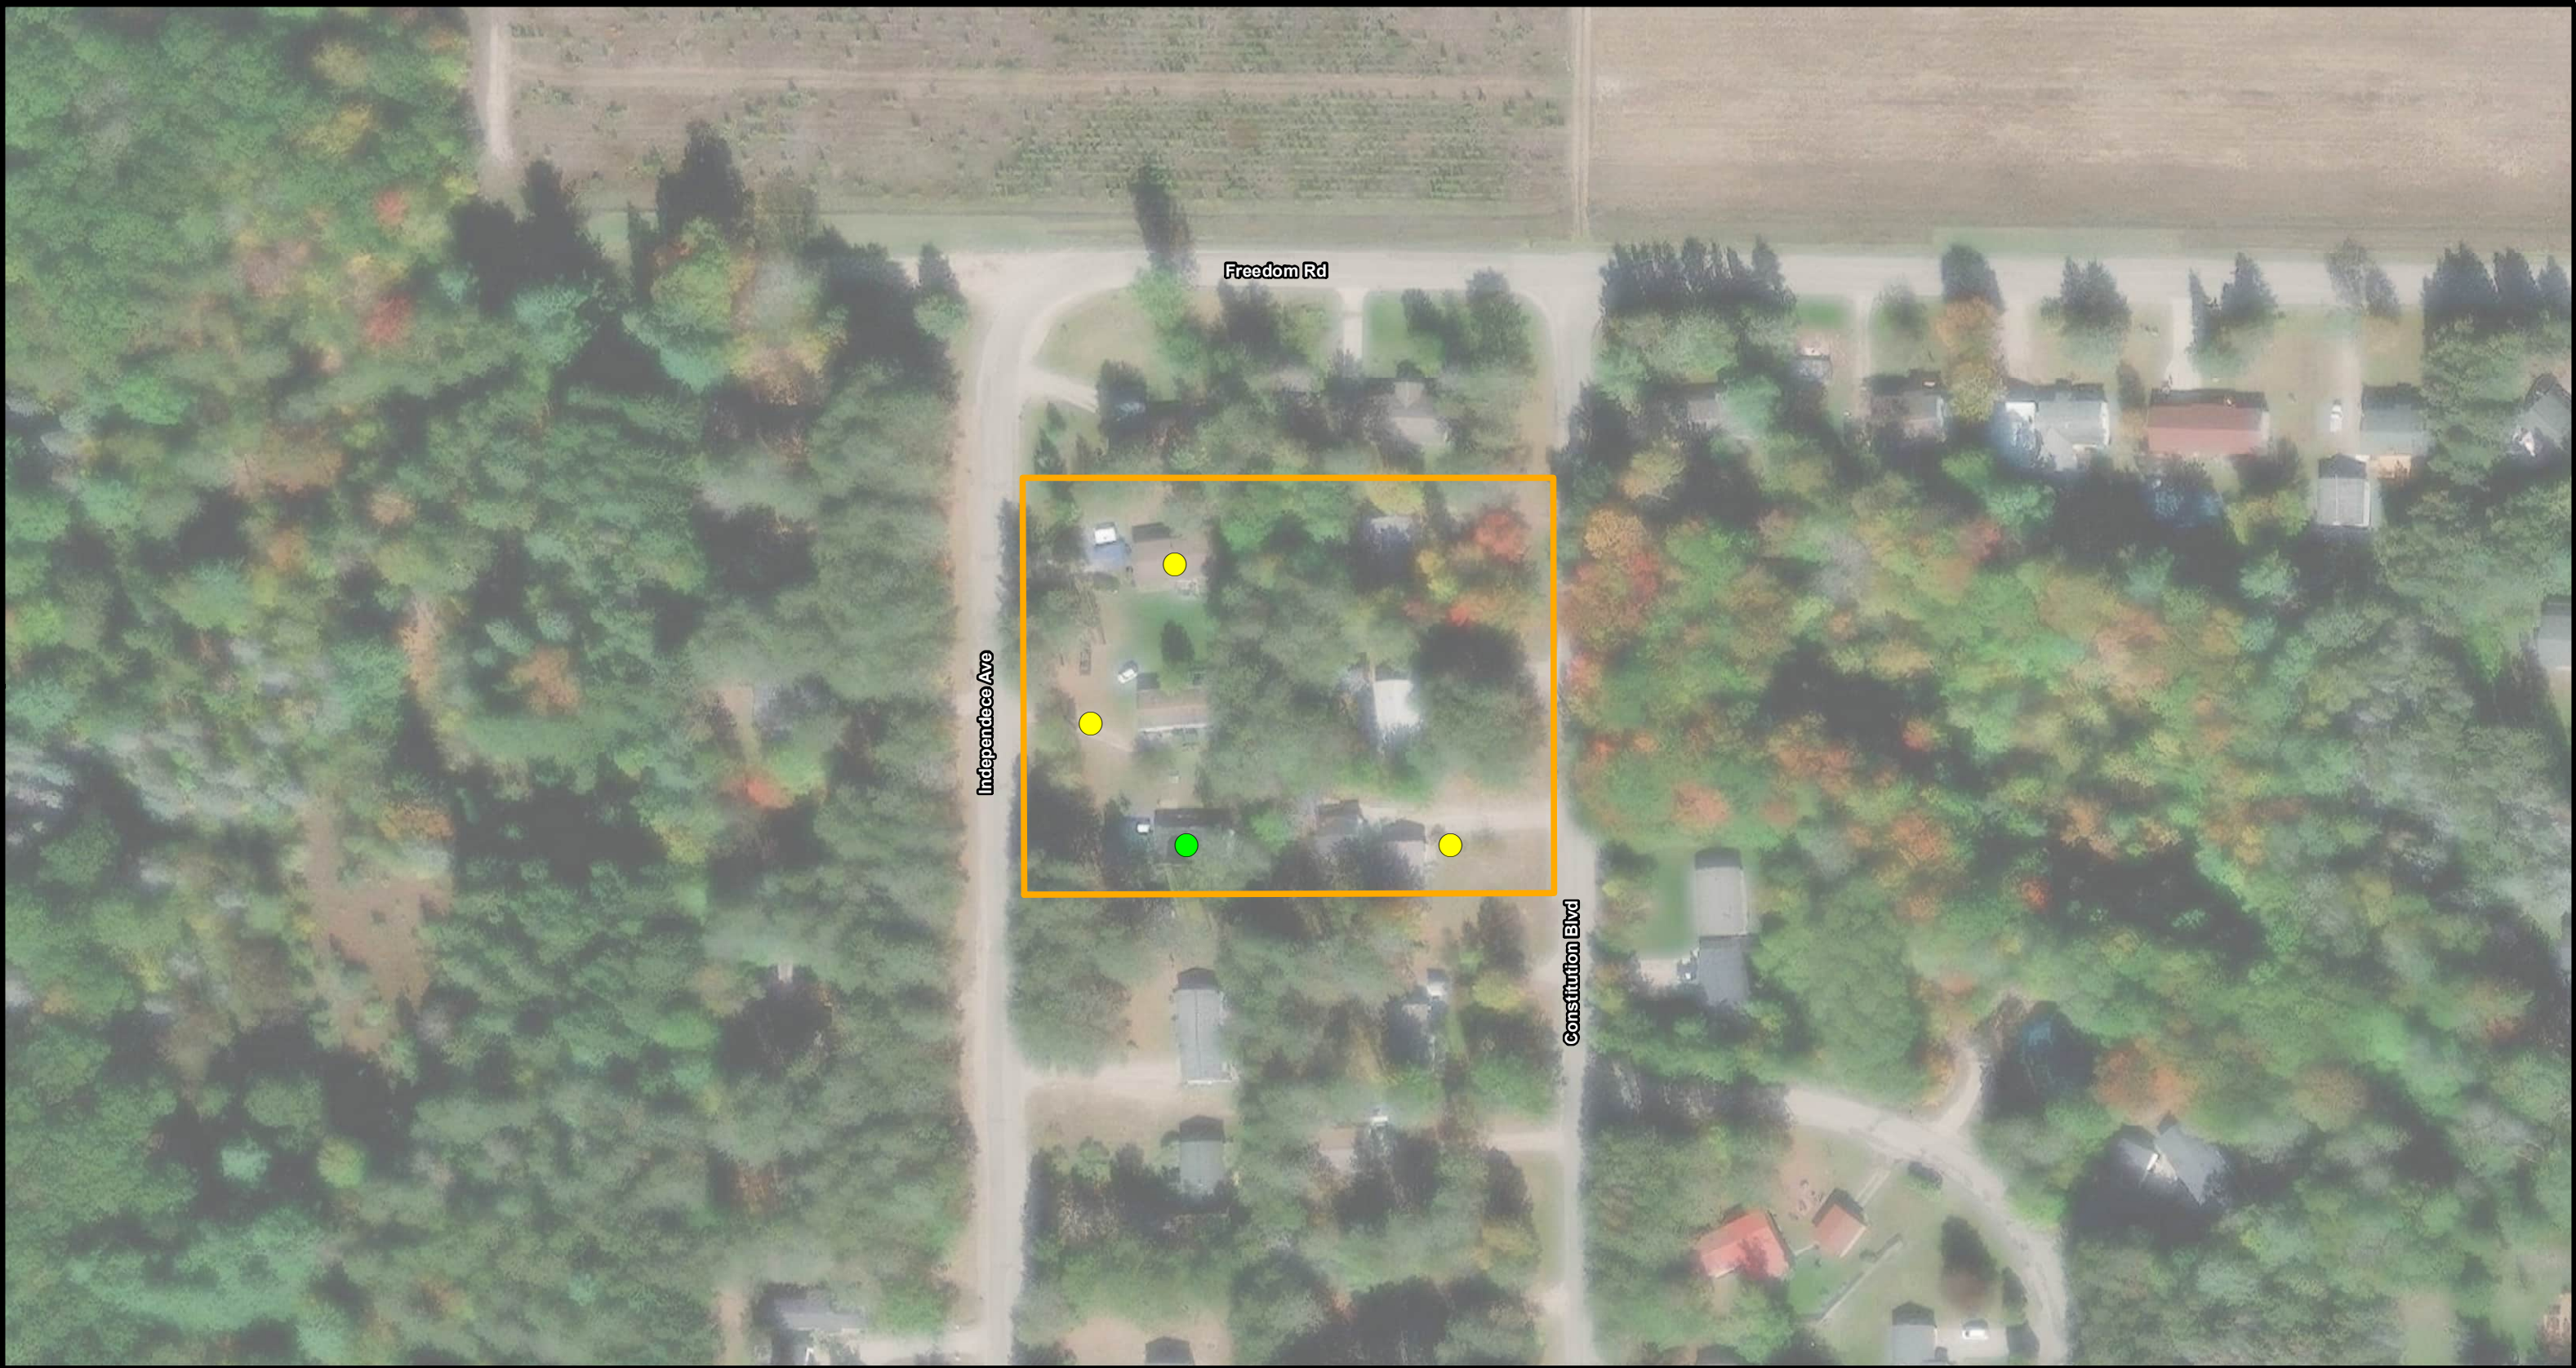

Drawn: AA

Date: 9/3/2025

Approved: DB

Date: 9/3/2025

Project #: 60560354



Legend

Drinking Water Well Sample

No Detections of the Analyzed PFAS Substances

One or more of the Analyzed PFAS Substances Detected

One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

Wexford AOI Sampling Area

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000

PFBS = 420

PFNA = 6

PFHxS = 51

PFOS = 16

HFPO-DA = 370

FIGURE 3

PFAS CRITERIA HEAT MAP

CONSTITUTION BLVD

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI



Drawn: AA

Date: 9/3/2025

Approved: DB

Date: 9/3/2025

Project #: 60560354



Legend

●

No Detections of the Analyzed PFAS Substances

●

One or more of the Analyzed PFAS Substances Detected

●

One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria

□

Wexford AOI Sampling Area

—

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000PFBS = 420

PFOA = 8PFHxS = 51

PFNA = 6PFOS = 16

HFPO-DA = 370

N

0125250

Feet

FIGURE 3

PFAS CRITERIA HEAT MAP

SOUTH 45 ROAD

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI