





Drawn: DP	Date: 5/22/2025
Approved: DB	Date: 5/22/2025
Project #: 60560354	



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC
- Detected at or Above Criteria
- Results Pending

Wexford AOI Sampling Area

— Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000	PFBS = 420
PFOA = 8	PFHxS = 51
PFNA = 6	PFOS = 16
HFPO-DA = 370	



0 175 350 Feet




FIGURE 3

PFAS CRITERIA HEAT MAP

WEST 32 ROAD, BOON

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI



Drawn: DP	Date: 5/22/2025
Approved: DB	Date: 5/22/2025
Project #: 60560354	



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC
- Detected at or Above Criteria
- Results Pending

Wexford AOI Sampling Area

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000	PFBS = 420
PFOA = 8	PFHxS = 51
PFNA = 6	PFOS = 16
HFPO-DA = 370	

0 100 200 Feet


FIGURE 3

PFAS CRITERIA HEAT MAP

EAST LAKE MITCHELL

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI

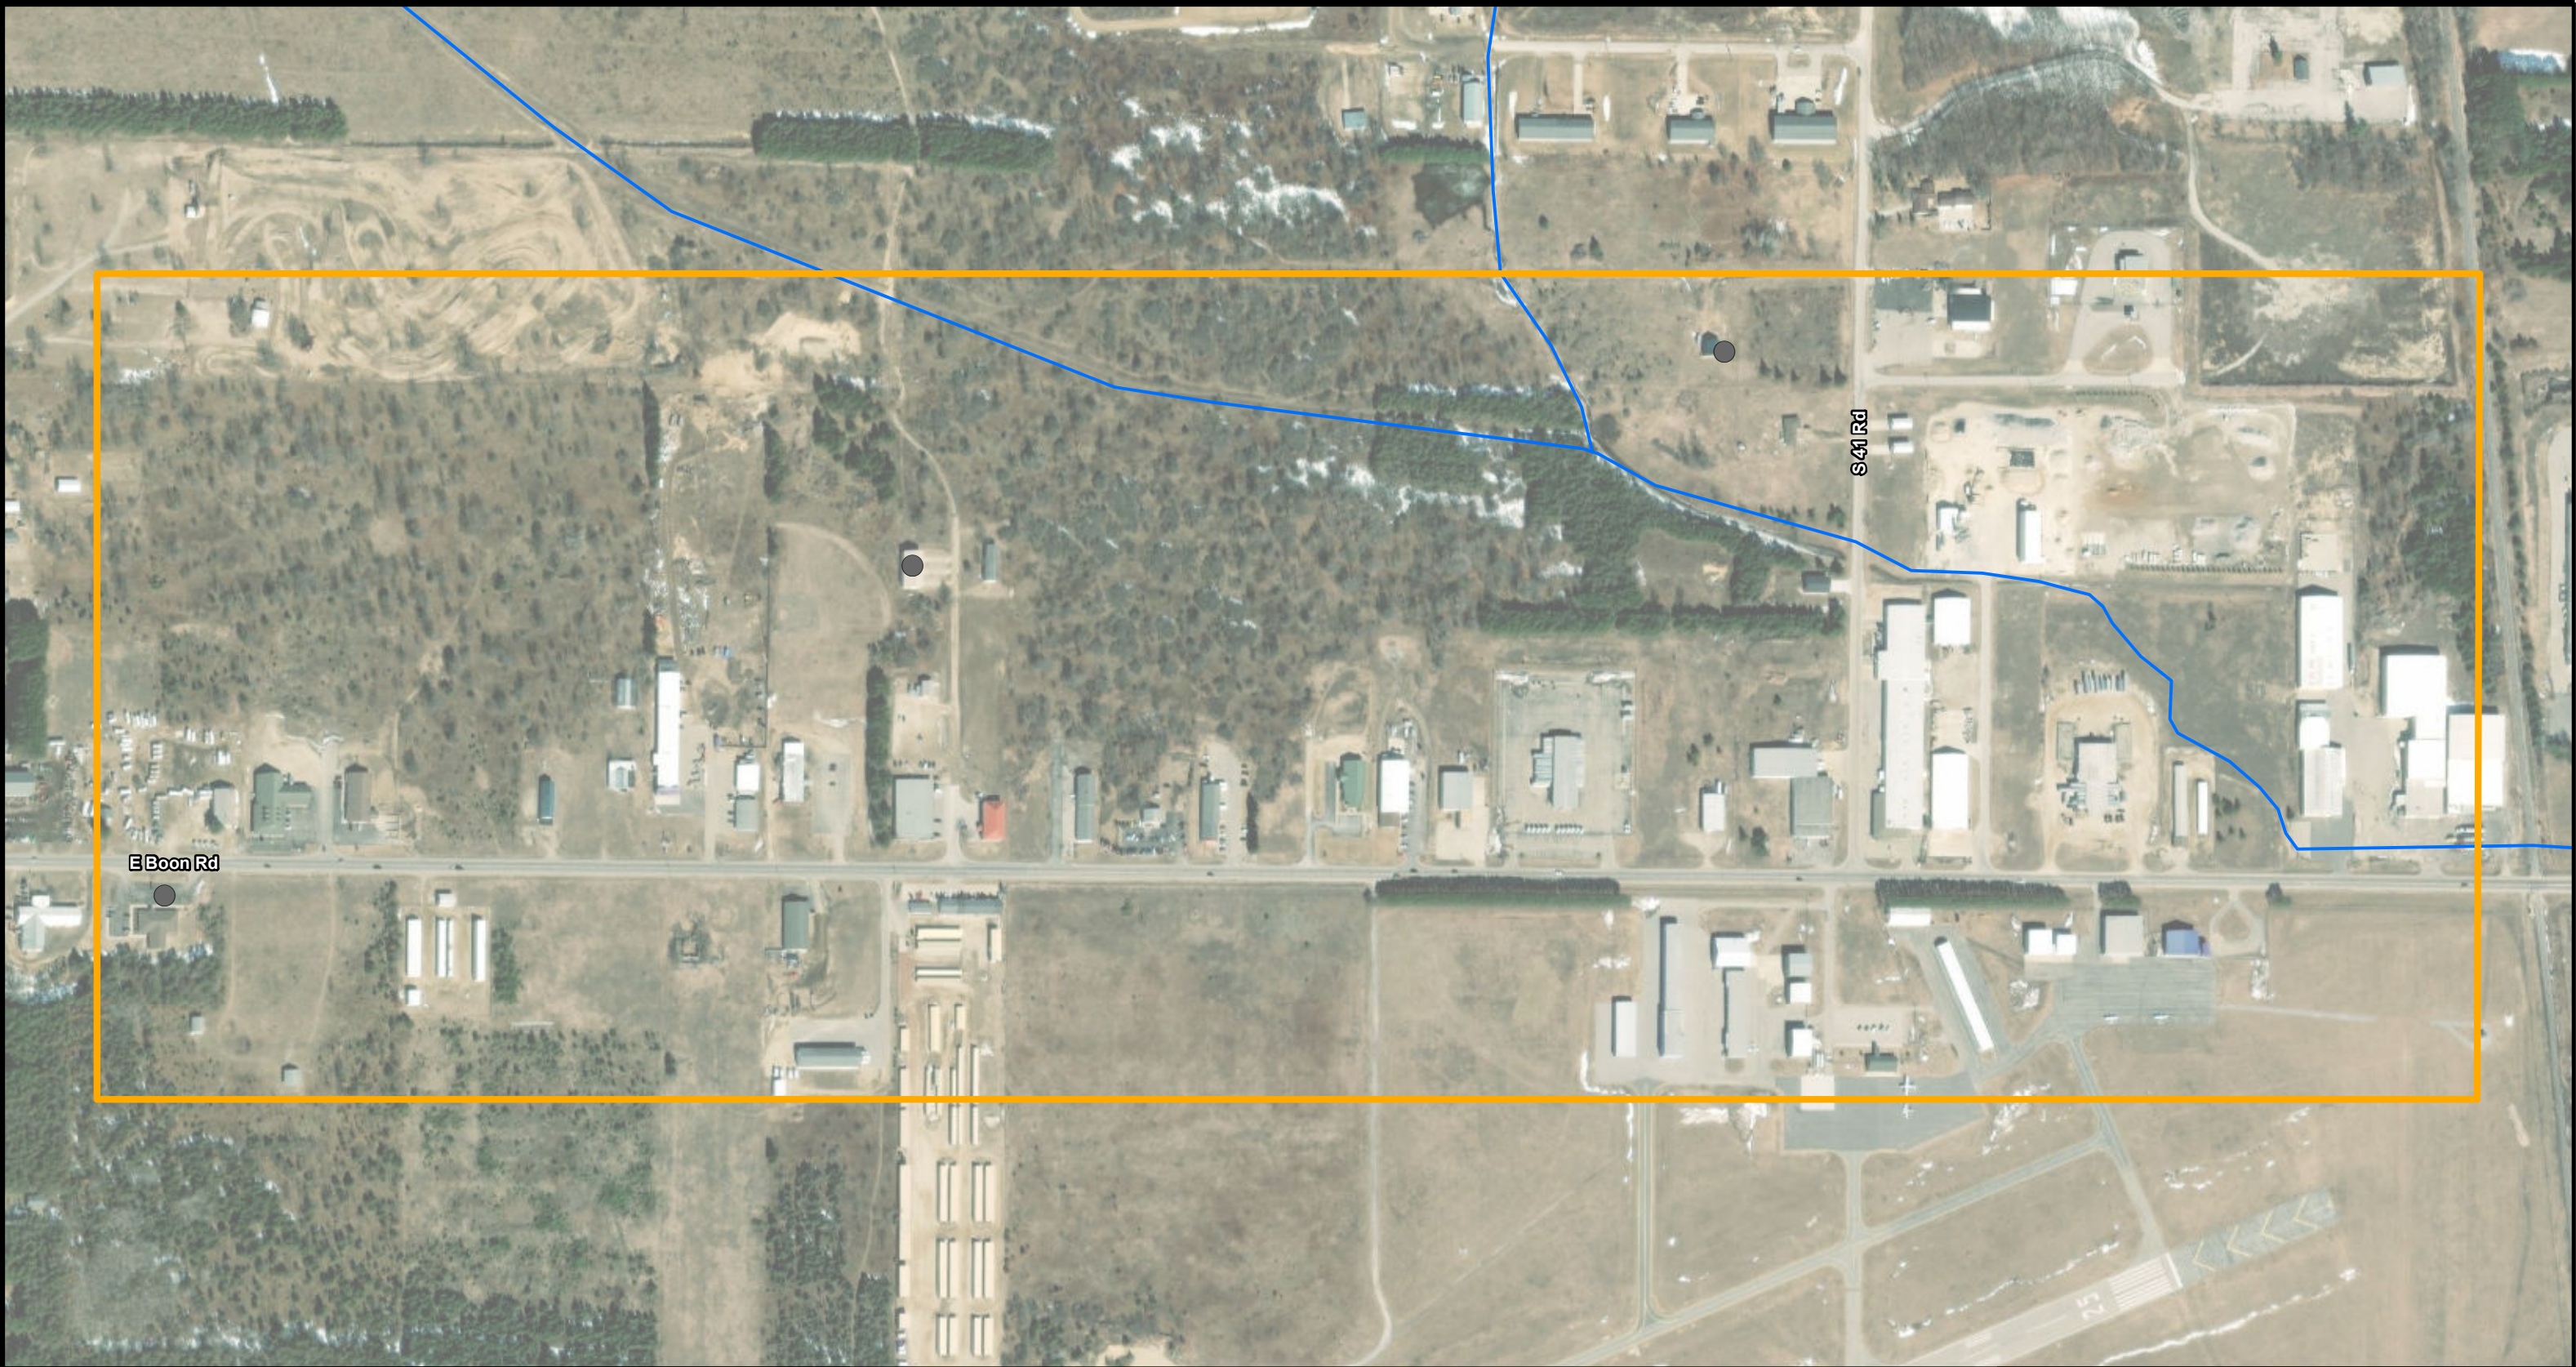

AECOM

Drawn: DP Date: 5/22/2025

Approved: DB Date: 5/22/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria
- Results Pending



Wexford AOI Sampling Area



Surface Water Body


Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFBS = 420
PFOA = 8 PFHxS = 51
PFNA = 6 PFOS = 16
HFPO-DA = 370



0 430 860 Feet

FIGURE 3
PFAS CRITERIA HEAT MAP
EAST 34/BOON ROAD

WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI

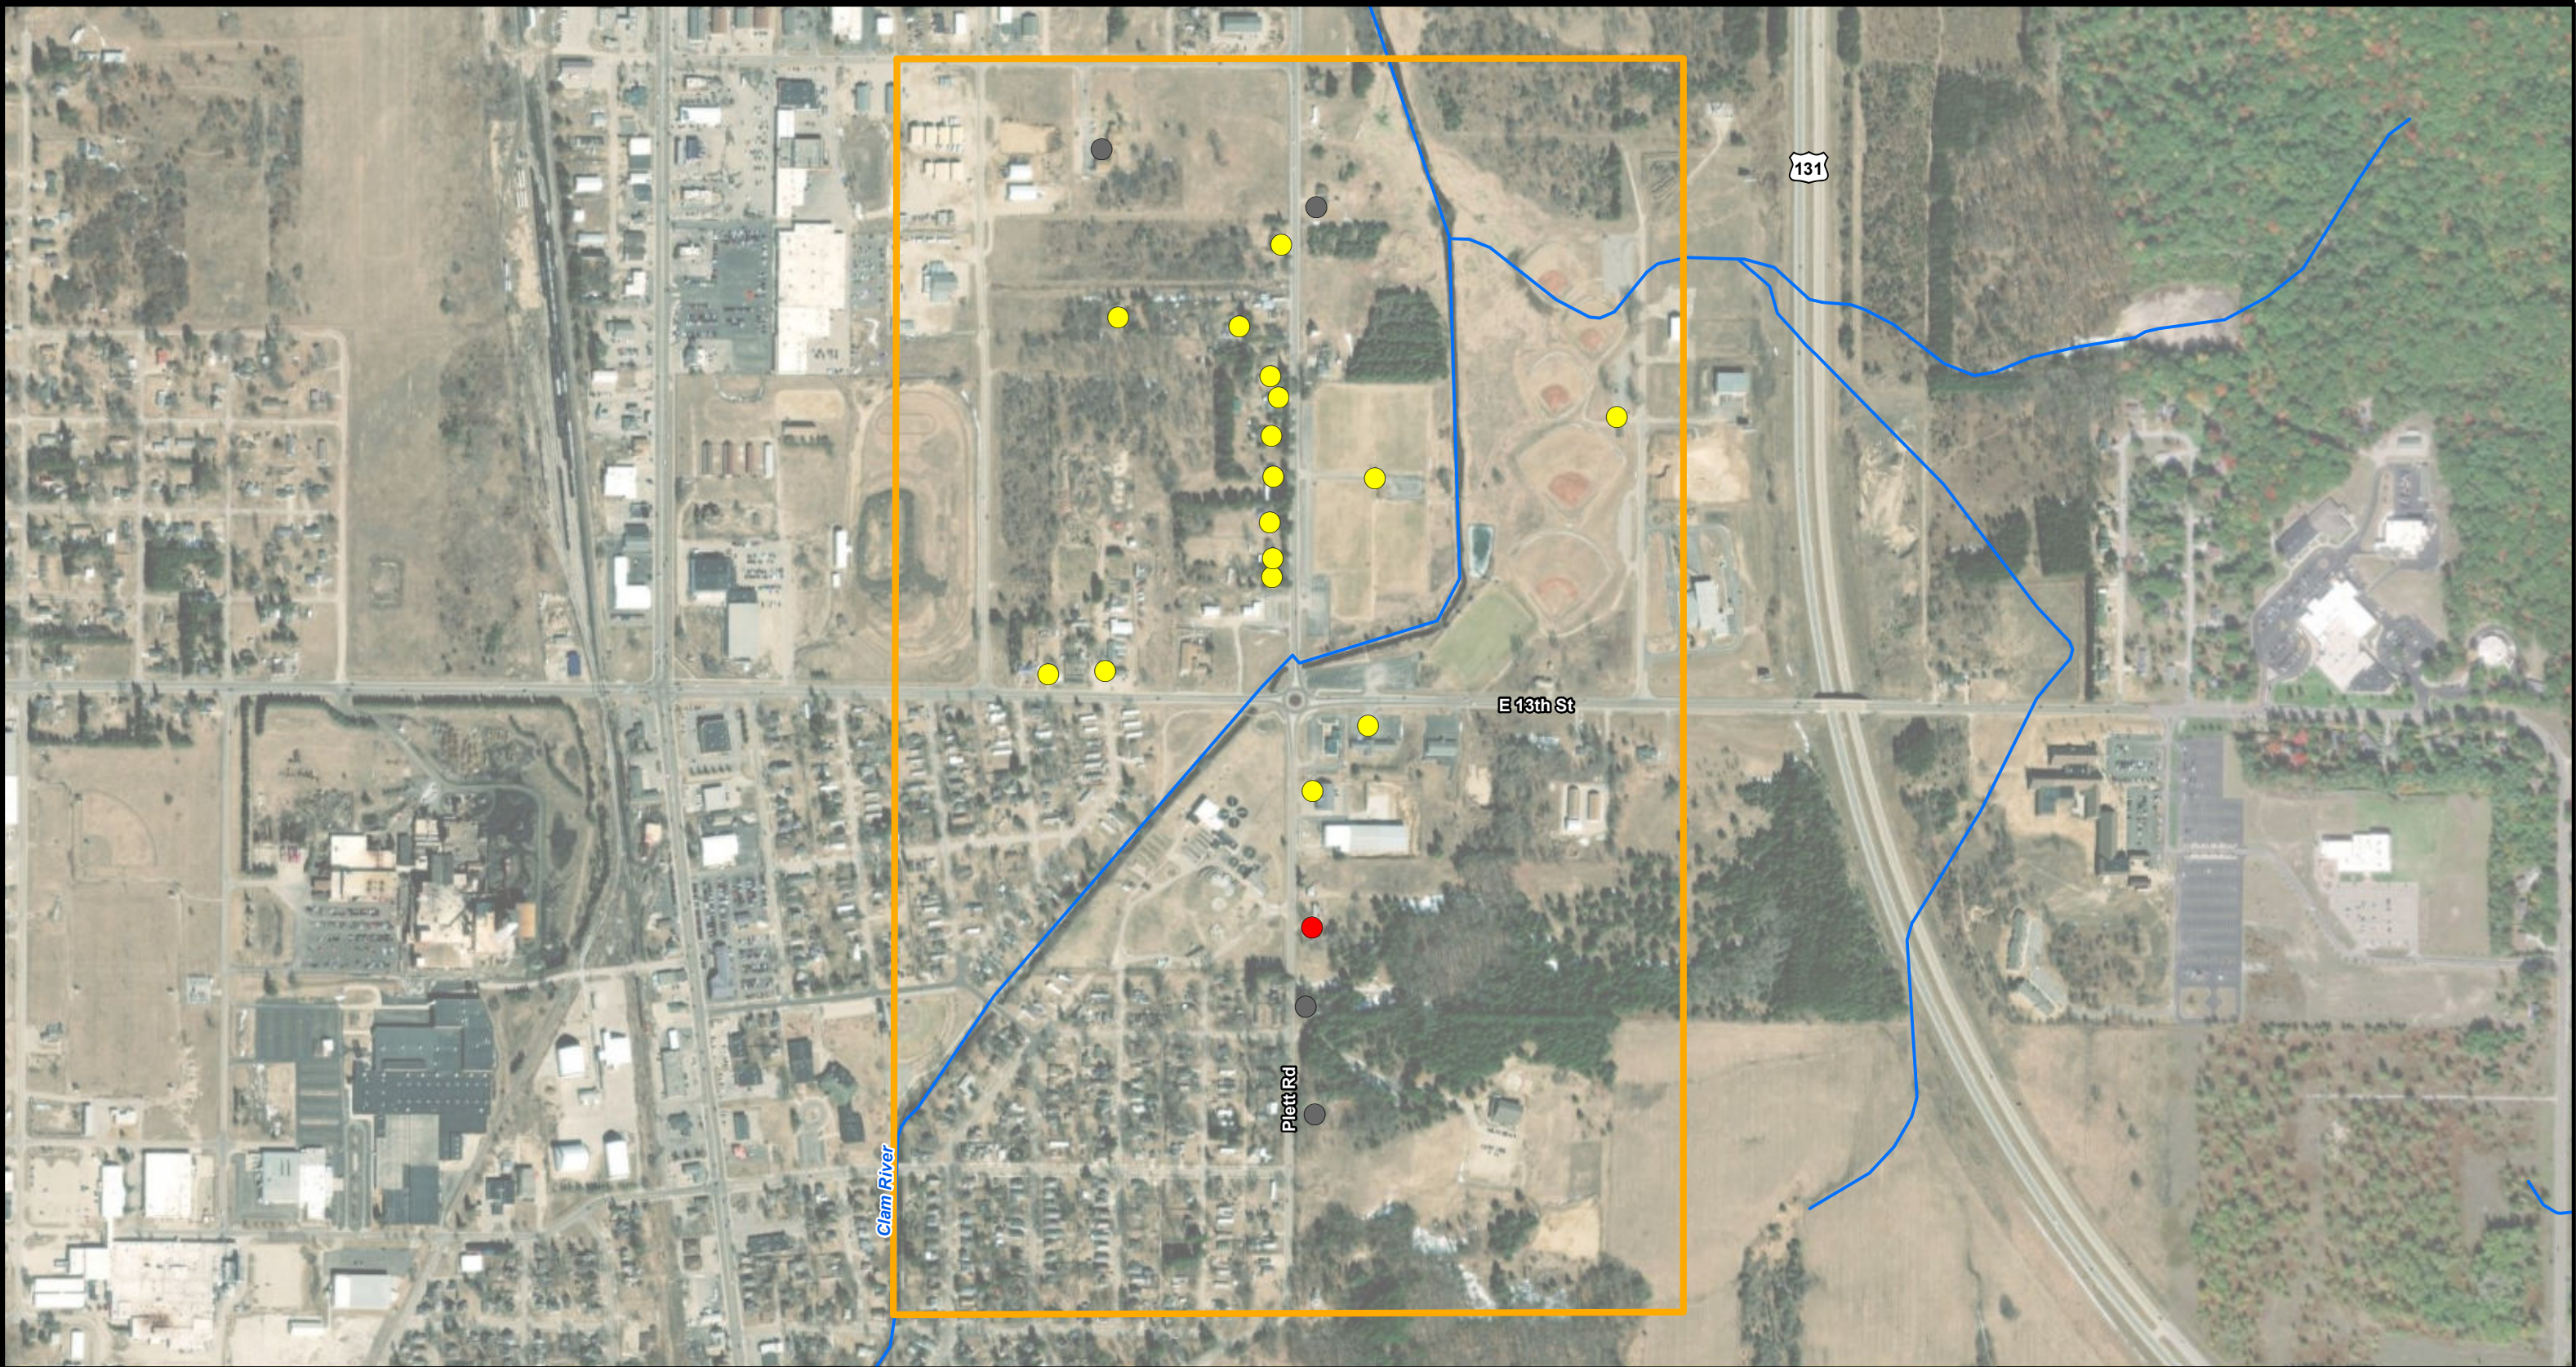

AECOM

Drawn: DP Date: 5/22/2025

Approved: DB Date: 5/22/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria
- Results Pending



Wexford AOI Sampling Area



Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt
PFHxA = 400,000 PFBS = 420
PFOA = 8 PFHxS = 51
PFNA = 6 PFOS = 16
HFPO-DA = 370



0 650 1,300 Feet

FIGURE 3
PFAS CRITERIA HEAT MAP
13TH & PLETT

WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI



Drawn: DP Date: 5/22/2025

Approved: DB Date: 5/22/2025

Project #: 60560354



Legend

Drinking Water Well Sample

- No Detections of the Analyzed PFAS Substances
- One or more of the Analyzed PFAS Substances Detected
- One or more of the 7 PFAS Substances with Michigan DWC Detected at or Above Criteria
- Results Pending



Wexford AOI Sampling Area

— Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,00

PFOA = 8
PFNA = 6

PFNA = 6
HEPO-DA = 370

HFFO-DA = 370



FIGURE 3
PFAS CRITERIA HEAT MAP
CONSTITUTION BLVD

WEXFORD AREA OF INTEREST
WEXFORD COUNTY, MI



Drawn: DP

Date: 5/22/2025

Approved: DB

Date: 5/22/2025

Project #: 60560354



Legend

●

No Detections of the Analyzed PFAS Substances

●

One or more of the Analyzed PFAS Substances Detected

●

One or more of the 7 PFAS Substances with Michigan DWC

●

Detected at or Above Criteria

●

Results Pending

□

Wexford AOI Sampling Area

—

Surface Water Body

Michigan Drinking Water Criteria (DWC), ppt

PFHxA = 400,000PFBS = 420

PFOA = 8PFHxS = 51

PFNA = 6PFOS = 16

HFPO-DA = 370

0125250

Feet

N

FIGURE 3

PFAS CRITERIA HEAT MAP

SOUTH 45 ROAD

WEXFORD AREA OF INTEREST

WEXFORD COUNTY, MI